

Skills for a greener world

EUIAS Level 3 End-point Assessment Apprentice Guide for

Power Industry Substation Fitter Construction

QAN 610/4850/1













EUIAS Level 3 End-point Assessment Apprentice Guide for

Power Industry Substation Fitter - Construction QAN 610/4850/1

Updates to this Guide	4
Introduction	7
How This Apprentice Guide Is Organised	7
How to Use This Guide	7
Section 1: The Basics	8
What is an apprenticeship standard?	8
What is an assessment plan?	8
What is an end-point assessment (EPA)?	9
What are the gateway requirements?	9
What is the EPA Specification?	10
Section 2: Apprentice EPA Journey	11
Let us Begin Your EPA Journey.	11
How will you be assessed in the end-point assessment?	11
Your EPA Journey in a Diagram	13
Section 3: End-point Assessment Components	
Component 1: Multiple-choice test	15
Practice Component 1: Multiple-choice test	20
Component 2: Interview based on an EPA portfolio	21
EPA Portfolio Requirements	23
Practice Component 2: Interview based on an EPA Portfolio	25
Component 3: Trade test practical assessment	26
Practice Component 3: Trade test practical assessment	31
EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) App Guide v1.1	prentice
Guide VI.T 610/4850/1 – ST01331 V1 2 © 2024 Energy & Utility Skills	Page 2



Component 4: Trade test technical interview	31
Practice Component 4: Trade test technical interview	34
Overall grading	34
Section 4: Resits and retakes	35
Section 5: Appendices	36
Appendix A: Glossary	37
Appendix B: EPA Portfolio Evidence Log	39
Construction	39



Updates to this Guide

Since the first publication of the EUIAS Power Industry Substation Fitter (PISF) -Construction Apprentice Guide, the following updates have been made.

Version	Date first published	Section updated	Page(s)
v1.1	November 2024	Standard updated (V1.2) to include statement 'The apprentice may choose to end the assessment method early.' For 3 assessment methods	22, 23, 31, 33
V1.0	October 2024	First published	All



At a Glance Component 1: Multiple-choice test

Date(s):	
Time:	
Location:	
Examination Conditions:	Controlled by an invigilator
Additional Requirements:	
Assessed and marked by:	EUIAS

At a Glance Component 2: Interview based on an EPA portfolio

Date(s):	
Time:	
Location:	
Examination Conditions:	With an EUIAS Independent assessor at your employer's premises or a suitable venue for example a training provider's premises
Additional Requirements:	EPA Portfolio to be completed and submitted at Gateway
Assessed and marked by:	1 independent assessor, approved by EUIAS.

At a Glance Component 3: Trade test practical assessment

Date(s):	
Time:	
Location:	
Examination Conditions:	Conducted in a simulated environment which reflects your natural work environment
Additional Requirements:	 Both the: multiple-choice test; and interview based on an EPA portfolio must be completed and passed before the trade test practical assessment with questions can take place.
Assessed and marked by:	1 employer assessor, approved by EUIAS.

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 5



At a Glance Component 4: Trade test technical interview

Date(s):	
Time:	
Location:	
Examination Conditions: With an employer assessor in your place work.	
Additional Requirements:	 Both the: multiple-choice test; and interview based on an EPA portfolio must be completed and passed before the trade test technical interview can take place.
Assessed and marked by:	1 employer assessor, approved by EUIAS.





Introduction



EUIAS has been selected by your employer to carry out end-point assessment (EPA) and it is our job to ensure that you are assessed fairly.

How This Apprentice Guide Is Organised

✓ Section 1:

What is in the Apprentice Guide?

✓ Section 2:

An Apprentice's End-point Assessment Journey

✓ Section 3:

End-point Assessment Components

How to Use This Guide



This guide has been split into 3 sections. You can dip into each section that you are working on where you will find useful information, practical advice, tips you need and useful dates to successfully complete your EPA.

Throughout we have used headings and cross referenced to our EPA Power Industry Substation Fitter (PISF) Specification which provides details of the EPA components.



Section 1: The Basics

What is an apprenticeship standard?



An apprenticeship standard is a description of your apprenticeship and it is based on the Power Industry Substation Fitter standard, which was written by employers. It contains the Substation Fitter's job profile, and describes the knowledge, skills and behaviours (KSBs):

- Knowledge: (as part of KSBs) specific information, technical detail, and 'know-how' identified as part of the apprenticeship standard that must be evidenced during your end-point assessment
- Skills: (as part of KSBs) the practical application of knowledge identified as part of the apprenticeship standard that must be evidenced during end-point assessment
- Behaviours (as part of KSBs) specific mindsets, attitudes or approaches identified as part of the apprenticeship standard that must be evidenced during end-point assessment

The standard can be accessed via the link below:

Power industry substation fitter / Institute for Apprenticeships and Technical Education

Select the occupational standard tab.

What is an assessment plan?

An Assessment Plan is also written by employers and provides details of what is required for you to pass your end-point assessment. It includes details of what you will be assessed on, how each assessment will take place, what methods will be used and who will assess you.

EUIAS designed the end-point assessment (EPA) to meet the requirements of the Assessment Plan. The Assessment Plan can be accessed via the link below: <u>Power industry substation fitter / Institute for Apprenticeships and Technical</u> <u>Education</u>

Select the EPA plan tab.

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 8



What is an end-point assessment (EPA)?

The end-point assessment is the assessments you take at the end of your apprenticeship. You will typically spend 30 months on-programme working towards your standard. You are required to spend a minimum of 12 months on-programme. After this you have a Gateway meeting with your employer or training provider to confirm you are ready for the end-point assessments. The words end-point means that you will be assessed at the end of your on-programme (training) to confirm you have met the standard. Your EPA period will typically last 6 months. The end-point assessments consist of 4 components:

- Multiple-choice test
- Interview based on your EPA portfolio
- Trade test practical assessment with questions
- Trade test technical interview

Each component has a provisional grade, and each grade is carried forward to award a final grade. You must pass all 4 components to pass your apprenticeship.

The final grade can be a Fail, Pass or Distinction.

What are the gateway requirements?

Gateway is a meeting where your employer, training provider and you ensure that you are confident that you can demonstrate all the KSBs defined in the apprenticeship standard and you are ready for EPA. After the meeting, your training provider will confirm the outcomes of the Gateway meeting by sending a signed document to EUIAS. The document confirms that you have met the following Gateway requirements:

- achieved English and mathematics qualifications in line with the apprenticeship funding rules
- have passed an emergency first aid 1 day course
- compiled an EPA portfolio, which your interview based on an EPA portfolio will be based

Your training provider will send copies of these documents to EUIAS.



What is the EPA Specification?

Substation Fitter	
Distribution maintenance; Construction)	Transmission maintenance;
Specification	
QAN 610/4850/1	

The end-point assessment specification provides details of:

- the assessment methods used in your EPA
- KSBs that are covered by each assessment
- KSBs amplification and guidance

The Specification can be accessed via the link below: <u>PISF-EPA-Specification-V1.1.pdf (euias.co.uk)</u>


EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 10



Section 2: Apprentice EPA Journey

Let us Begin Your EPA Journey.

Find a quiet place and read on....



Power Industry Substation Fitter is a core and options apprenticeship standard. You must be trained and assessed against the core and one of the following options:

- Distribution maintenance
- Transmission maintenance
- Construction

This Apprentice Guide is for apprentices following the **construction** option. Separate Apprentice Guides are available for those following either distribution maintenance or transmission maintenance.

Your EPA journey consists of 3 elements:

- A training programme with on the job, off the job elements, typically 30 months
- Gateway meeting window
- End-point Assessment (EPA) typically 6 months

Your journey begins with the training program. Your employer and training provider are responsible for this part. This is where you will gain the required Knowledge, Skills and Behaviours (KSBs).

How will you be assessed in the end-point assessment?

You will be assessed on the following components:

- 1. Multiple-choice test
- 2. Interview based on your EPA portfolio
- 3. Trade test practical assessment with questions
- 4. Trade test technical interview

The multiple-choice test and interview based on an EPA portfolio **must be completed and passed before** the trade test practical assessment and trade test technical interview can take place.



It is important for you to keep a record of when your 4 components are scheduled. We suggest you use the 'At a Glance' tables on pages 5 - 6.

You must pass all 4 components to achieve this qualification. For further guidance refer to Section 3 End-point Assessment Components.

Reasonable adjustments

A reasonable adjustment is any action that helps to reduce the effect of a disability or difficulty that places you at a substantial disadvantage during assessments. If this applies to you make sure you tell your training provider who can make an application for a reasonable adjustment to EUIAS on your behalf.



Your EPA Journey in a Diagram


The diagram below illustrates the order of your EPA journey from the day you register to your final certification:

Training	Gateway and scheduling 4 components	Multiple-choice test	Interview based on an EPA portfolio	Continued on next page
()		()	C V	
Typically, 30 months	You have: Attended a Gateway meeting with your employer/provider Achieved English and mathematics qualifications in line with the apprenticeship funding rules	60 minutes Multiple-choice 40 questions Under exam conditions supervised by an invigilator. Face to face	75 minutes Time may increase by up to 10%, to allow you to complete your last answer Under examination conditions. Face to face or remote as agreed and recorded using relevant	The multiple-choice test and interview based on an EPA portfolio must be completed and passed before the trade test practical assessment and trade test technical interview can take place
	Passed an emergency first aid 1 day course Compiled an EPA portfolio, which your first interview will be based on	Closed book See below for further details	technology Independent assessor See below for further details	

*For further details refer to Section 3 in this Apprentice Guide or Section 2 of the Specification.

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 13



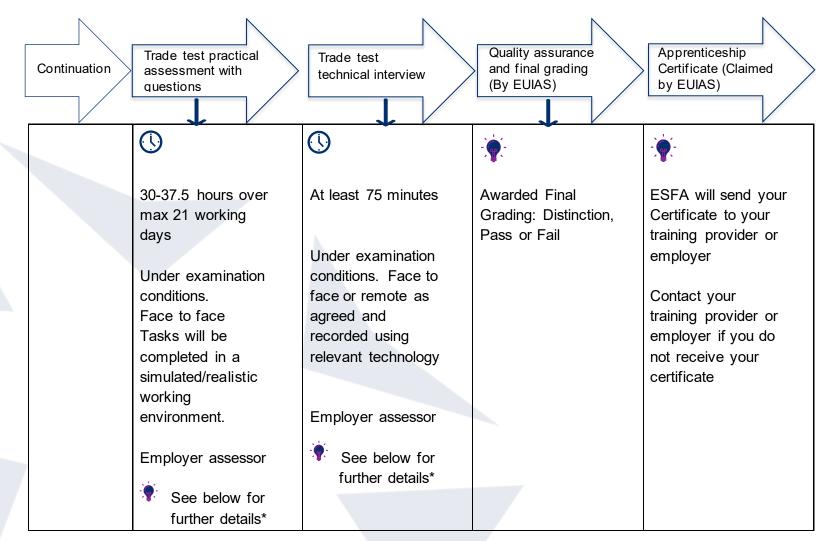

• For further details refer to Section 3 in this Apprentice Guide or Section 2 of the Specification.

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 14



Section 3: End-point Assessment Components

Now let us continue your journey through EPA. There are 4 components that you must pass to be awarded a certificate.

Component 1: Multiple-choice test

Overview

The multiple-choice test is paper based. You will have 60 minutes to complete the test. The test consists of 40 questions.

The multiple-choice questions will have four possible answers of which one will be correct.

Step-by-Step Guide

The table below provides a step-by-step guide on how the multiple-choice test will be carried out:

Who will	You will sit your multiple-choice test in the presence of an invigilator.
start and	
finish my	
multiple-	
choice	
test?	
What	The test may be paper-based or taken online. Your training provider
format will	will let you know what the format of your test is.
my test	
take?	All other aspects of the test are exactly the same, including:
	content
	• timings
	question types
	• scoring



How will	Here is an example of how the question will appear:		
the			
question	Question 1		
appear in a	In a workplace, who is responsible for maintaining health and		
paper-	safety?		
based test?	Possible answers		
	a) Employers		
	b) Safety managers		
	c) Most senior person on-site		
	d) Everyone		

You must **select one answer** that you think is correct. You will be provided with an answer sheet where you will be expected to shade in the answer you have selected. Here is an example:

Candidate ID		Attempt
Last Name		
Exam Date		Paper
Centre Number		
MARKING INSTRUCTIONS		
◎ ◎ ◎ ● ANSWER CON	PLETED CORRECTLY	
Examples of how NOT to mark	your examination sheet. These will	not be recorded
	ally shade the answer circle.	
o o o o o bonor para		
	circles.	
	circles.	41 0 0 0 0
⊙ ⊙ ⊙ DO NOT use of ⊙ ⊙ ● DO NOT shad	circles. le over more than one circle.	41 © © © © 42 © © © ©

Always have a go even if you are not sure that it is the correct answer.



How will	Here is an example of here the question will appear in an online
	Here is an example of how the question will appear in an online version of the test:
the	version of the test.
question	
appear in	Default • v1.2485
an online	Questions (3/3 > INSTRUCTIONS E FINISH (2) 10m
test?	1 2 3 What is the capital of Poland?
	1 mark
	O Warsaw
	O Athens
	O Rome
	O Riga
	You must select one answer that you think is correct.
Can I take	The test is closed book which means that you cannot refer to
any	reference books or any other materials. You will be provided with
resources	appropriate stationery on the day.
into the	
exam	
room?	
Can I have	No access to the internet is allowed and this means you must not
internet	take your SMART watch into the exam room.
access?	
How will	Locations: Your multiple-choice test will take place at your
the	employer's or training provider's premises or a suitable venue.
multiple-	• You will take the test in a quiet space and in the presence of
choice test	an invigilator
be	 Your test will be scheduled by your employer or training
organised	provider with the EUIAS
for me?	• If you fail the multiple-choice test, you can re-sit or re-take the
	failed test at your employer's discretion. There are no limits to
	the number of re-sits or re-takes you can take but it is
	important to revise and ensure that you are confident with the
	knowledge you are being tested on



What	The multiple-	choice test questions are based on the core knowledge
criteria will I	•	s component. Below is a list of the knowledge criteria,
have to	assessed in t	he multiple-choice test along with an indication of the
learn?	number of qu	estions, targeting each criterion, that will be asked in a
	multiple-choid	ce test paper:
AND	Number of	
	Questions	Knowledge
How many		
questions	Core	
will be	1 - 3	K1: Power network industry appreciation: generation of
asked on		electricity, Transmission Network Operator, Distribution
each		Network Operator (DNO), Independent Distribution
criteria?		Network Operator (IDNO), Independent Connections
		Provider (ICP), supplier, generators - role and boundary of operation.
		·
	1 - 2	K2 : The office of gas and electricity markets (Ofgem) - their role and powers.
	1 - 3	K3: Power industry regulations: Electricity at Work
		Regulations, and The Electricity Safety, Quality and
		Continuity Regulations (ESQCR). Their purpose and
		basic requirements.
	1 - 3	K6: Business operation considerations: how activities
		may impact customers, financial constraints (budgets),
		penalties and rewards, ethical business practices.
	5 - 7	K9: Health and safety regulations, standards, and
		guidance - their purpose and basic requirements:
		asbestos awareness, Construction Design Management
		(CDM), Health and Safety at Work Act, Control of Substances Hazardous to Health (COSHH), Lifting
		Operations and Lifting Equipment Regulations (LOLER),
		lone working, Management of Health and Safety at Work,
		Provision and Use of Work Equipment Regulations
		(PUWER), Reporting of Injuries, Diseases and
		Dangerous Occurrences Regulations (RIDDOR), and
		warning signs and symbols.
	1 - 2	K14: Working in confined spaces awareness.




1 - 2	K17 : The Environmental Protection Act – its purpose and basic requirements.
1 - 3	K20: Oil: containment, storage, disposal, spill management escalation and reporting, and specialist risk assessment.
1 - 3	K21: Sulfur hexafluoride (SF6): regulations, procedures, certification requirements for handling, reporting leaks.
3 - 5	K30 : Mathematical theory in power engineering. Round numbers, scientific notation, percentages and ratios. Areas, perimeters, volumes and surface areas of simple shapes. Scales, tables, graphs and charts. Pythagoras' Theorem and sin, cos, and tan in right-angled triangles. Substitution of numerical values into simple engineering formulae. The sequence of arithmetic operations.
3 - 5	K31: Mechanical theory in power engineering. Mass, force and weight. Parameters of mechanical systems. The components of hydraulic and pneumatic systems. Statics and forces. Energy, work and power. The parameters of material tensile strengths. The parameters of mechanical advantage. The lever principle and theorem of movement.
1 - 3	K32 : Electrical theory in power engineering. Circuit technology. Magnetism and electromagnetism. Transformers.
1 - 2	K33 : Power engineering electrical networks: generation, transmission, distribution and transformation of system voltages.
1 - 3	K34 : Power engineering electrical plant and apparatus, the properties and purpose of transformers, switchgear, earthing devices, voltage control and automated equipment.
1 - 2	K35: The symptoms and causes of common faults on electrical power circuits, plant and apparatus.
6 - 8	K36: Substation high-voltage (HV) and low-voltage (LV) equipment and its purpose: air compressors, busbars,



	circuit breakers, current transformers and voltage transformers, earthing systems and associated equipment, electrical switchgear, multi-core cabling, HV metering, isolators, primary equipment and connections, protection and control systems, telecontrol and automation equipment, transformer cooling, transformers, substation batteries, and AVCS systems (automatic voltage control systems).
	Remember the questions have been written to reflect the Power Industry Substation Fitter role as a whole and are not focussed on specific plant, machinery, or employer-specific processes. For amplification and guidance refer to Section 3 of the PISF Specification (see link on page 10).
What	You should be prepared to:
should I do	 revise the core knowledge criteria listed above (K1, K2, K3,
to prepare	K6, K9, K14, K17, K20, K21, K30, K31, K32, K33, K34, K35
for the	and K36)
multiple-	 ask your employer or training provider for additional
choice	questions that they have prepared to support you
test?	 attend the multiple-choice test which will last 60 minutes
	While on-programme, the employer or training provider must ensure you are:
	 familiar with all areas assessed by the multiple- choice test
	as listed above
	 supported in completing a practice test and provide you with
	constructive feedback to enable you to identify areas you
	need to carry out further revision in

Practice Component 1: Multiple-choice test





Component 2: Interview based on an EPA portfolio

Overview

The first interview is based on your EPA portfolio. It is to allow you to demonstrate how you have met the KSBs in order to carry out your occupational role as a Power Industry Substation Fitter effectively and safely. The interview allows for testing of responses where there are a range of potential answers.

Step-by-Step Guide

The table below provides a step-by-step guide on how the interview based on an EPA portfolio will be carried out:

Who will assess me?	1 independent assessor, appointed by EUIAS will assess you under examination conditions.
How will the interview be organised?	Locations: Your interview will take place at your employer's premises or a suitable venue.
Ŭ	Time: The interview must last 75 minutes for apprentices following the construction option
	The independent assessor has the option to increase the time of your interview by up to 10%, to allow you to complete your last
	answer. You may choose to end the interview early. You must be
	confident you have demonstrated competence against the assessment requirements for the interview. The independent
	assessment requirements for the interview. The independent assessor will ensure you are fully aware of all assessment requirements. The independent assessor may suggest the assessment continues.
	The independent assessor cannot suggest or choose to end this interview early (unless in an emergency).
	Your interview will be:a discussion between you and the independent assessor



 face to face or remote, as agreed assessed and outcomes will be recorded by the assessor on official EUIAS interview documents recorded using the relevant technology such as Microsoft Teams or an audio recording device You will have access to your EPA portfolio throughout the interview.
 The interview focuses on the four tasks in your EPA portfolio: 1. Communication and working with others 2. Sustainability 3. CPD and improvement activities 4. Location and avoidance of utilities
For further details refer to 'Knowledge, Skills and Behaviours (KSBs) coverage in the PISF Specification on pages 21 – 32. A link to the PISF Specification is available on page 10.
 A minimum of 7 questions for apprentices following the construction option Set questions which will be contextualised to the contents of your portfolio Follow-up questions in order to seek clarification
The independent assessor will award a provisional grade. You must pass ALL the pass criteria in order to achieve a pass. To achieve a Distinction you must successfully achieve ALL the Pass criteria and ALL of the Distinction criteria.
Fail, Pass or Distinction.
You may choose to end the interview early. You must be confident you have demonstrated competence against the assessment requirements for the interview. The independent assessor will ensure you are fully aware of all assessment requirements and understand the implications of ending the interview early. The independent assessor may suggest the



	interview continues. The independent assessor will document your request to end the assessment early.
Can the independent assessor end the interview early?	The independent assessor cannot suggest or choose to end the assessment methods early, unless in an emergency.

EPA Portfolio Requirements

The requirements are as follows:

EPA Portfolio Template

Throughout the on-programme part of your apprenticeship you must compile an EPA portfolio to support you in your first interview. During the interview the independent assessor will ask questions based on the evidence contained in your EPA portfolio.

For further guidance refer to:

- Section below 'How do I organise my portfolio of evidence?'
- PISF Specification Section 5: Guidance on EPA portfolio

How do I organise my EPA portfolio?

Step-by-Step Guide

You must complete an EPA portfolio template. You should request the EPA Portfolio Template from your provider

The EPA portfolio template comprises four tasks to support the compilation of the portfolio. Each task should help you focus on the specific knowledge, skills and behaviours that will be assessed in the interview.

For each task there is:

- a series of questions to be answered
- a text box following each question for you to provide your response. These boxes will expand to take more text; however, quality of answer is more



important than quantity. You will be able to use your answers as prompts in the interview

 tables for you to record evidence that supports the examples provided in response to the questions. A copy of the tables can be found in Appendix B

Your EPA portfolio is **not assessed**. It serves the following purposes:

- A carefully prepared EPA portfolio will support you during the interview
- Your organised EPA portfolio will allow you to refer to examples and discuss the evidence with the independent assessor
- It allows the assessor to review it before the interview to help focus and contextualise the questions that you will be asked.

What should I include in my EPA portfolio?

Quality vs quantity

You should be supported in selecting evidence for your EPA portfolio by your employer or training provider.

We would advise you to choose the best pieces of evidence to support the answer to each question in the EPA portfolio template. The completed EPA portfolio should contain the four tasks with your responses and at least one piece of evidence backing up each of the questions. A piece of evidence may cover more than one question. No other evidence should be included.

Examples of acceptable evidence:

- workplace documentation/records, for example job task sheets/job card/times sheets, equipment maintenance /service records related to the apprentice
- witness statements signed and dated by coaches/trainers
- employer contributions that focus only on direct observation of evidence (for example witness statements) rather than opinions
- annotated photographs/video clips with a maximum total duration of 10 minutes showing the apprentice carrying out tasks
- diagrams

The above is not a definitive list. You can include other relevant evidence sources.

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 24





You must not include in your portfolio any methods of self-assessment.

Evidence must be:

- produced by you (authentic)
- relevant to the task
- cross referenced and easily accessible in the portfolio
- produced during the time you were carrying out your on-programme training

What can I do to prepare for the interview?

You should:

- ensure there is quality evidence to cover the answer to each question in the EPA portfolio template
- be familiar with the structure of your EPA portfolio
- know the tasks/KSBs covered by the interview
- know where you have referenced your evidence by referring to your EPA Portfolio Evidence Log. A copy is included in Appendix B
- know how you will be graded

The role of your employer or training provider

Employers or training providers are expected to support you in preparing your portfolio by:

- providing clear instruction and deadlines to allow you to plan and compile your portfolio in preparation for the Gateway meeting
- advising on which pieces of evidence to select
- authenticating evidence as valid
- signing off the EPA portfolio
- submitting the portfolio to EUIAS as part of Gateway requirements.

Practice Component 2: Interview based on an EPA Portfolio

You should have an opportunity to have a practice interview which mirrors the real assessment. The practice interview would be set up by your employer or training provider using the structure in the table above.



Component 3: Trade test practical assessment

Overview

A trade test practical assessment involves an employer assessor, approved by EUIAS observing and questioning you undertaking tasks in a simulated/realistic working environment. The task(s) must be capable of being completed by a competent substation fitter.

Step-by-Step Guide



The table below provides a step-by-step guide on how the trade test practical assessment will be carried out:

Structure of your observation	The total assessment time is 30-37.5 hours
	• The trade test practical assessment may take place in parts but must be completed over no more than 21 working days. A working day is typically considered to be 7.5 hours long. The reason for this split is that you will need to complete several tasks, which may require work on different apparatus.
Where will the assessment take place?	 In a simulated environment which closely relates to your natural work environment
What	Prepare for substation fitter activities (core)
knowledge, skills and behaviours	K22 : Planning, prioritising, organisation, and time management techniques for self and working party.
(KSBs) do I have to demonstrate	S1 : Review drawings, instructions, or information to understand the task for example, work instructions, design specifications, utility plans, on-line search documents.
during the	specifications, duity plans, on-line search documents.
during the practical assessment?	Specifications , utility plans, on-line search documents. S2 : Prioritise and plan tasks with consideration for safety, environmental impact, quality, and cost.



S18: Select, check, and prepare resources.

Organise and supervise a working party (core)

S5: Receive and clear a safety document. Brief a working party.

B3: Take ownership for work and responsibility for its impact on others. For example, self-motivated, disciplined in the approach to work tasks, identify and deal appropriately with distractions to enable tasks to be achieved, work carried out in line with standards.

Maintain work site health, safety, and environment compliance including completing a risk assessment (core)

K7: The hazards associated with work on or near electrical power networks.

K10: Risk assessments and method statements. Emergency procedures. Personal protective equipment (PPE). Manual handling. Fire safety.

K19: Recycling and waste transfer requirements.

K37: Hazards and controls for access and egress of operational substation sites: security, pre-entry checks, logging in requirements, automatic or remotely operated equipment, and fire suppression systems.

S6: Follow substation access and egress procedures.

S7: Identify hazards and risks and apply control measures.

S8: Apply health and safety procedures in compliance with regulations, standards, and guidance. For example, demarcate the work area, working at height, confined spaces, COSHH.

S10: Apply measures to leave power work environments in a safe condition.



S13: Segregate waste for reuse, recycling, and waste transfer.

B1: Prioritise health and safety. For example, risk aware, minimise risks, and proactively work towards preventing accidents.

Identify apparatus (core)

S4: Identify apparatus to be worked on.

Tools and equipment (core)

K23: Hand tools and power tools application and operation requirements. Insulated tools - selection and care considerations.

S17: Select, check, prepare, use, and store hand tools and power tools.

Complete work records (core)

K25: Documentation requirements; importance of accurate records.

S23: Record information.

Use engineering representations, drawings, and graphical information (construction)

K67: Engineering representations, drawings, and graphical information: application and importance.

S73: Read, interpret, and follow representations, drawings, and graphical information to complete tasks. For example, multicore diagrams, schematics, and core sheets.

Follow construction safety requirements (construction)

K75: Lifting operations – rigging and slinging.

S74: Prove plant, equipment, cabling, and system is safe to work on. For example, prove dead, isolate.



S75: Check earthing is in place. For example, additional earths, equipment earths, and drain earths.

S76: Follow lifting plan.

Install new substation equipment (construction)

K73: Fixing systems: unistrut, rawl bolts, chemical fixing anchors and proof loading, shims, and grouting for base plates.

S79: Locate and fix high voltage switchgear.

Install earthing associated with substations (construction)

K68: Commercial gas: storage, transportation, and safe use.

K72: System earthing requirements: selection of materials and equipment for above and below ground earthing systems, installation, mechanical connections, welding, and brazing.

S81: Apply mechanical connections, brazing, and welding techniques.

S82: Lay and fix earth tape within excavation and to plant and equipment.

Install and terminate multi-core cables and containment systems (construction)

K70: Multi-core wiring requirements: installation, termination (glanding, looming, crimping, and ferruling), labelling and identification system.

S85: Select, position, and connect multi-core wiring including glanding, looming, crimping, and ferruling. For example, panel wiring within a protection panel and switchgear. Apply labelling and identification system.

Conduct testing on installed equipment (construction)

K76: Testing procedures: voltage, polarity, insulation resistance, three-phase testing, phase rotation, earth loop impedance, continuity, and joint resistance.



	K82: Mechanical testing requirements.
	K83: Oil sampling methods and requirements.
	S86 : Use test instruments. For example, volt meters, multi- function tester, and resistance tester.
	S87 : Conduct mechanical testing. For example, torque and proof loading.
	S88: Conduct alignment checks.
	S89 : Take oil samples for testing.
	S91: Interpret test results and action as required.
	For amplification and guidance refer to the PISF
	Specification: <u>PISF-EPA-Specification-V1.1.pdf (euias.co.uk)</u>
What tasks will	The task(s) must allow you to undertake the activities required for
I have to	a practical assessment. For further details refer to 'Knowledge,
cover?	Skills and Behaviours (KSBs) Coverage' in Section 2 of the PISF
	Specification. Refer to link above.
What resources can I	Equipment and resources needed for the practical assessment will be:
use?	 provided by your employer
	 the tools, equipment and PPE required for the job
	 in good and safe working condition
	Relevant work instructions/manuals must be available in hard
	copy or electronically.
How many	The employer assessor:
questions will I	 will ask at least 9 open questions from your employer's
be asked?	question bank
	 may ask follow-up questions in order to seek clarification
	from you
Who will	An employer assessor, approved by EUIAS.
assess me?	
Provisional	The employer assessor will award a provisional grade. You must
Grading	pass ALL the pass criteria in order to achieve a pass.



	To achieve a Distinction you must successfully achieve ALL the
	Pass criteria and ALL of the Distinction criteria.
Overall grading for this component	Fail, Pass or Distinction
Can I finish the	You may abagage to and the trade test prestical early. You must
trade test practical early?	You may choose to end the trade test practical early. You must be confident you have demonstrated competence against the assessment requirements for the trade test practical. The employer assessor will ensure you are fully aware of all assessment requirements and understand the implications of ending the trade test practical early. The employer assessor may suggest the trade test practical continues. The employer assessor will document your request to end the assessment early.
Can the employer assessor end the trade test practical early?	The employer assessor cannot suggest or choose to end the trade test practical early, unless in an emergency.

Practice Component 3: Trade test practical assessment

You should have an opportunity to have a practice trade test which mirrors the real assessment. A practice trade test would be set up for you by your employer or training provider using the structure in the table above.

Component 4: Trade test technical interview

Overview

The trade test technical interview allows you to demonstrate the KSBs mapped to this assessment method. The interview allows for testing of responses where there are a range of potential answers that cannot be tested through the multiple-choice test.



Step-by-Step Guide

The table below provides a step-by-step guide on how the trade test technical interview will be carried out:

Who will	1 employer assessor, approved by EUIAS will assess you under	
assess me?	examination conditions.	
How will the	Locations: Your interview will take place at your employer's	
interview be	premises or a suitable venue.	
organised?	Time: Your technical interview will last at least 75 minutes	
	Your interview will be:	
	 a discussion between you and the employer assessor 	
	 face to face or remote, as agreed 	
	 assessed and outcomes will be recorded by the assessor 	
	on official EUIAS-approved technical interview documents	
	 recorded using the relevant technology such as Microsoft 	
	Teams or an audio recording device	
What topics	The interview focuses on core themes and themes based on your	
will I have to	option:	
cover?	Core	
	1. Role and responsibilities	
	2. Electrical danger - control and first aid	
	3. Working at height	
	4. Asset security	
	5. Insulating mediums	
	6. Methods of cooling transformers	
	7. Handling and transportation of insulation oil	
	8. Determining insulating oil integrity	
	Construction	
	9. Construction equipment and cabling installation	
	10. AC/DC (alternating current and direct current) supply	
	power cable and power wiring installation	
	11. Diagnostic fault-finding techniques	
	12. Plant and equipment locking devices and interlocking	
	systems requirements	
	13. Producing wiring core sheets from wiring diagrams	



	14. Replacing components
	15. Removing cabling and equipment
	For further details refer to 'Knowledge, Skills and Behaviours
	(KSBs) coverage in the PISF Specification on pages 88 – 122.
	A link to the PISF Specification is available on page 10.
How many	A minimum of 10 questions
questions will I	 Follow-up questions in order to seek clarification
be asked?	
Provisional	The employer assessor will award a provisional grade. You must
Grading	pass ALL the pass criteria in order to achieve a pass.
Overall grading	Fail or Pass.
for this	
component	
Can I finish the	You may choose to end the trade test technical interview early.
trade test	You must be confident you have demonstrated competence
technical	against the assessment requirements for the trade test technical
interview	interview. The employer assessor will ensure you are fully aware
early?	of all assessment requirements and understand the implications
,	of ending the trade test technical interview early. The employer
	assessor may suggest the trade test technical interview
	continues. The employer assessor will document your request to
	end the assessment early.
Can the	The employer assessor cannot suggest or choose to end the
employer	trade test technical interview early, unless in an emergency.
assessor end	· ,
the trade test	
technical	
interview	
early?	



Practice Component 4: Trade test technical interview

You should have an opportunity to have a practice technical interview which mirrors the real assessment. The practice technical interview would be set up by your employer or training provider using the structure in the table above.

Overall grading

All assessment components contribute equally to your overall EPA grade.

Grades from individual assessment components will be combined in the following way to determine your overall EPA grade as a whole.

Multiple- choice test	Interview based on an EPA portfolio	Trade test practical assessment with questions	Trade test technical interview	Overall grading
Fail in any component				Fail
Pass	Pass	Pass	Pass	Pass
Pass	Distinction	Pass	Pass	Pass
Pass	Pass	Distinction	Pass	Pass
Pass	Distinction	Distinction	Pass	Distinction



Section 4: Resits and retakes

If you fail one or more EPA components you can re-sit or a re-take the failed component at your employer's discretion. Your employer needs to agree that a re-sit or re-take is appropriate. A re-sit does not need further learning, but a re-take does. You should have a supportive action plan to prepare for your re-sit or re-take.

Your employer and EUIAS will agree the timescale for your re-sit or re-take. A re-sit is typically taken within 4 months of the EPA outcome notification. Failed EPA component(s) must be re-sat or re-taken within the 6 months of the fail notification, otherwise the entire EPA will need to be re-sat or re-taken in full, unless in the opinion of the EUIAS exceptional circumstances apply outside the control of you or your employer.

Where any assessment method has to be re-sat or re-taken, you will be awarded a maximum EPA grade of pass, unless EUIAS determines there are exceptional circumstances which required a re-sit or re-take.

Re-sits and re-takes will not be offered to you if you wish to move from pass to a higher grade.

The EUIAS resit and re-take policy can be found at: https://www.euias.co.uk/end-point-assessment/policies-and-fees/



Section 5: Appendices

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 36



Appendix A: Glossary

Amplification – provides more detail on how individual knowledge, skills or behaviours statements should be interpreted. Where the KSB statements, themselves are deemed self-explanatory, no amplification is provided. Assessment may include questions on anything identified in the amplification

Behaviours –mindsets, attitudes or approaches needed for competence. Whilst these can be innate or instinctive, they can also be learnt. Behaviours tend to be very transferable. They may be more similar across occupations than knowledge and skills. For example, team worker, adaptable and professional

Elements – are the knowledge, skills and behaviours and what is needed to competently undertake the duties required for an occupational standard

Employer Assessor – provided by the employer and approved by EUIAS. Will assess the knowledge, skills and behaviours (KSBs) that you have been taught throughout the apprenticeship. Their role as an Employer Assessor would involve assessing component 3 (trade test practical assessment with questions) and component 4 (trade test technical interview)

Guidance – is only provided where it is required to support interpretation of the KSB statements

Gateway – the stage of the apprenticeship where the apprentice, employer and trainer determine whether the apprentice is ready to undertake the End-Point Assessment

Independent Assessor – will holistically assess the knowledge, skills and behaviours (KSBs) that you have been taught throughout the apprenticeship. Their role as an Independent Assessor would involve assessing component 2 (interview based on your EPA portfolio)

Knowledge – the information, technical detail, and 'know-how' that someone needs to have and understand to successfully carry out the duties. Some knowledge will be occupation-specific, whereas some may be more generic

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) ApprenticeGuide v1.1610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility SkillsPage 37



Options / **Options** – a specialist route within an occupational standard that builds on the occupational competence for a new entrant to the occupation

Skills – the practical application of knowledge needed to successfully undertake the duties. They are learnt through on and/or off-the-job training or experience

Standard – An occupational standard is a description of an occupation. It contains occupational profile, and describes KSBs needed for someone to be competent in the occupation's duties. The occupational standards are developed by employers for occupations that meet the Institute for Apprenticeships & Technical Education current criteria. For further details refer to:

Power industry substation fitter / Institute for Apprenticeships and Technical Education

Topic - is a collection of elements grouped into a theme e.g., Health and Safety



Appendix B: EPA Portfolio Evidence Log

Construction

Employer Name

Full Name of Apprentice	
The work submitted in this EPA portfolio is my own	
Date	

Supervisor/Mentor Name	
The work submitted in this EPA portfolio is the apprentice's own	
Date	

Task 1: Communication and working with others			
Supporting evidence provided (please check box)			
Date of activity	Description of evidence		Reference

Please add additional lines if needed

Task 2: Sustainability		
Supporting evidence provided (please check box)		
Date of activity	Description of evidence	Reference

Please add additional lines if needed



Task 3: CPD and improvement activities		
Supporting evidence provided (please check box)		
Date of activity	Description of evidence	Reference

Please add additional lines if needed

Task 4: Location and avoidance of utilities		
Supporting evidence provided (please check box)		
Date of activity	Description of evidence	Reference

Please add additional lines if needed



© Energy & Utility Skills

All rights reserved. No part of this publication may be reproduced, stored in a retrievable system, or transmitted in any form or by any means whatsoever without prior written permission from the copyright holder.

www.euskills.co.uk

EUIAS Level 3 End-point Assessment for Power Industry Substation Fitter (Construction) Apprentice Guide v1.1 610/4850/1 – ST01331 V1.2 © 2024 Energy & Utility Skills Page 41